

Grayson Pump Station


- Phase 1:
- (1) - 4 MG GST
 - (2) - 5,000 gpm Pumps
- Phase 2:
- (2) - 4 MG GST
 - (3) - 5,000 gpm Pumps

Colin Pump Station

- (1) - 1.5 MG GST
 - (1) - 2,733 GPM Pump
 - (1) - 1,000 GPM Pump
- Phase 1:
- (1) - 4 MG GST
 - (1) - 3,450 GPM Pumps
 - (1) - 2,733 GPM Pump
- Phase 2:
- (1) - 4 MG GST
 - (1) - 3,450 GPM Pumps

Sherley Pump Station

- Phase 1:
- (1) - 3 MG GST
 - (2) - 3,450 GPM Pumps
- Phase 2:
- (1) - 3 MG GST
 - (2) - 3,450 GPM Pumps
- Phase 3:
- (1) - 3 MG GST
 - (1) - 3,450 GPM Pumps

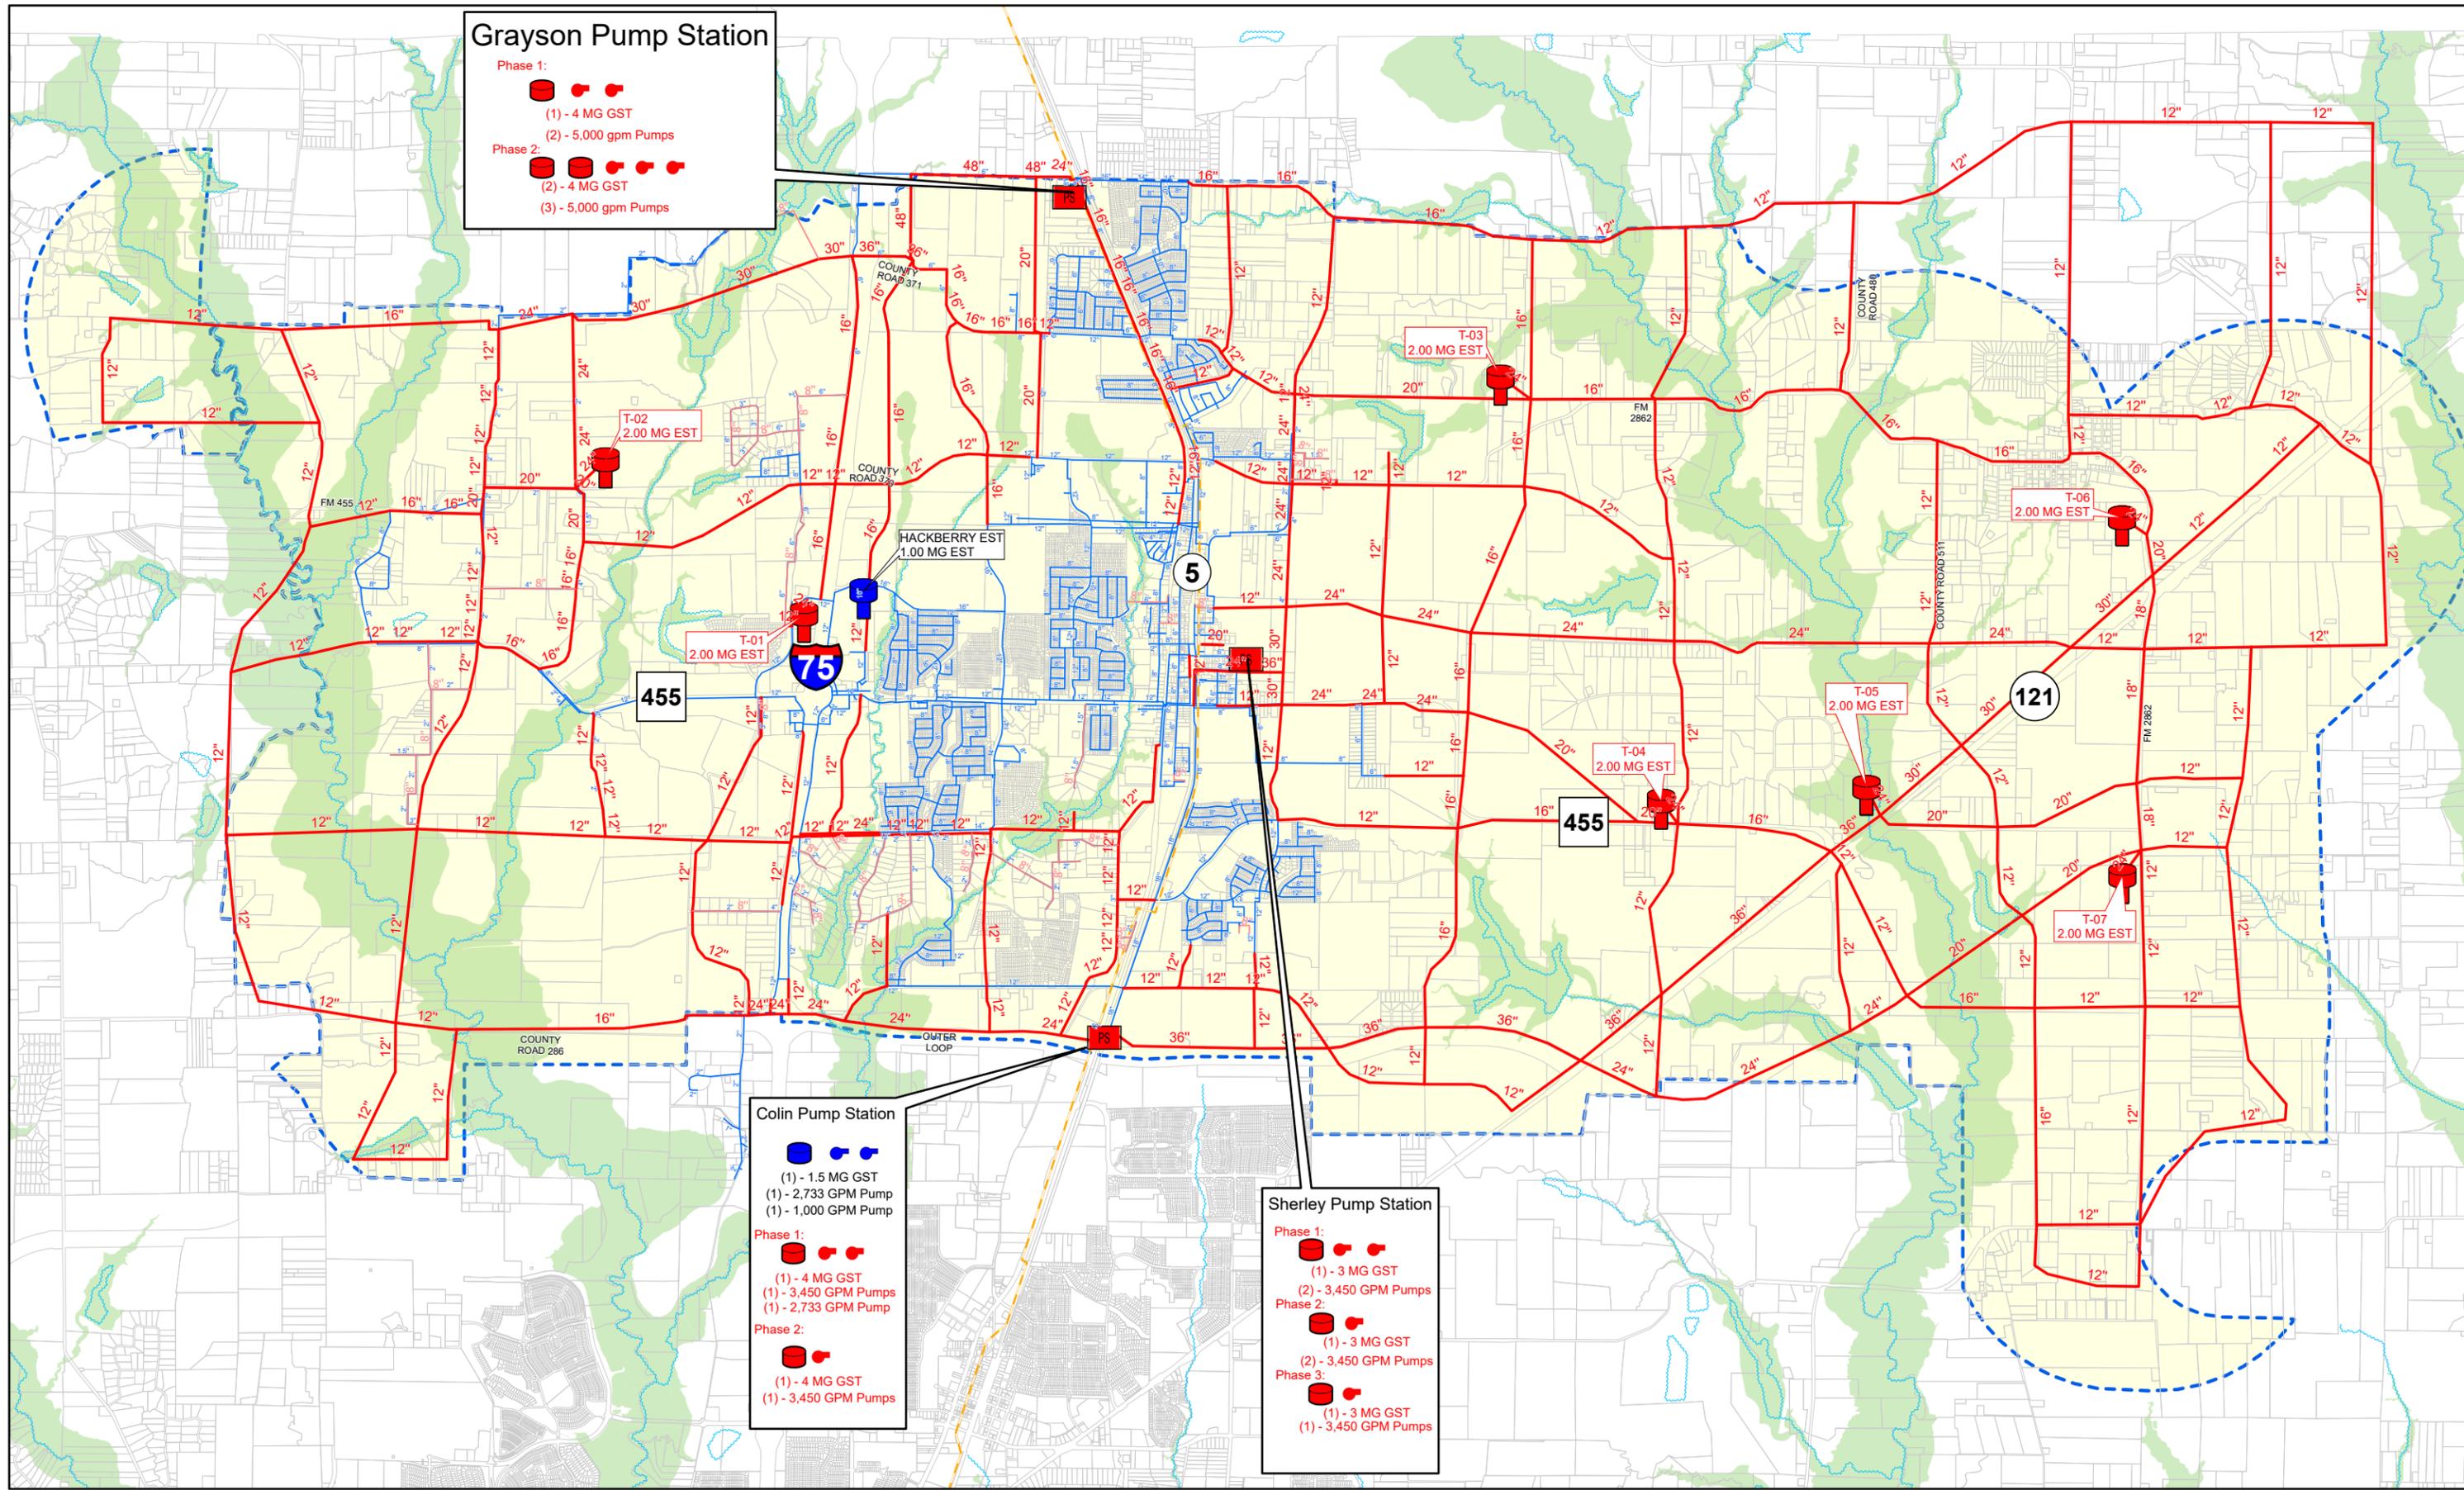

Kimley-Horn and Associates, Inc.
 File Path: K:\MKN_CityOfAnna_Water Master Plan\Area_Water Master Plan.aprx
 Date Saved: 2/22/2022 1:54 PM

Existing Elevated Tank	Future Pump Station	Minimum 8" Upgrades	Planning Boundary
Future Elevated Tank	Existing 24" GTUA Water Pipe	Future Water Pipe	Existing Ground Tank & Pump
Existing Water Pipe	Floodplain	Proposed Ground Tank & Pump	

Kimley Horn THE CITY OF **Anna**

CITY OF ANNA
 WATER MASTER PLAN

FIGURE
WMP